
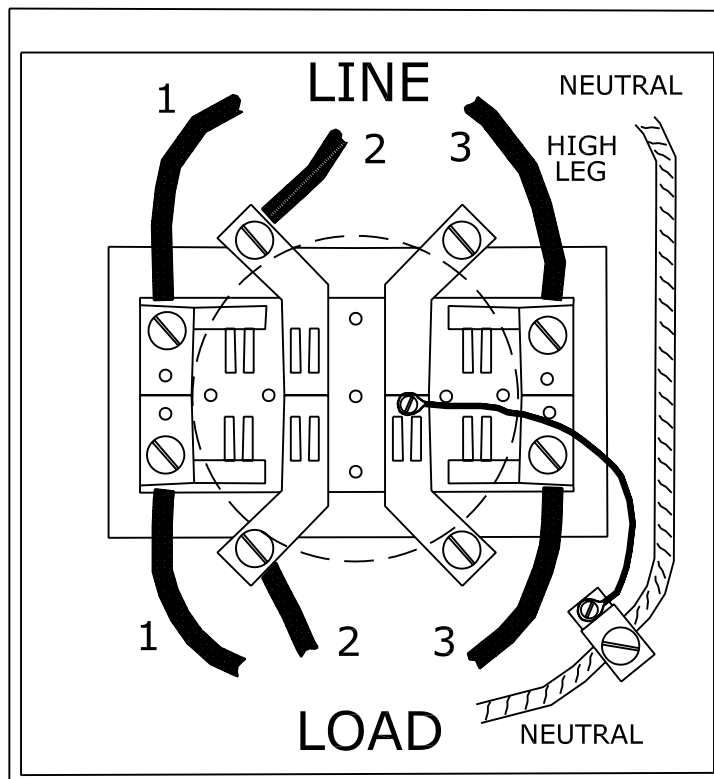


# THREE-PHASE DELTA SELF CONTAINED METERING

- Meter base will be provided by the Cooperative.
- Maximum 320 amp service. For larger services, transformer rated metering will be used (contact the Engineering Department).
- HIGH LEG must be marked with red or orange at the weatherhead, in the meter base, and in the main disconnect.

## CONNECTIONS

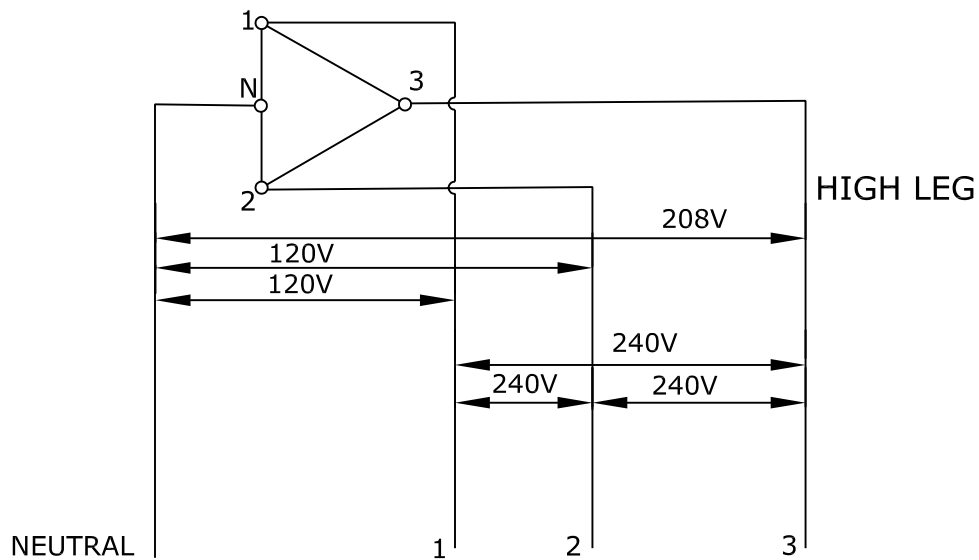

Revised 4/11/03 by LB

**FIGURE 2**