
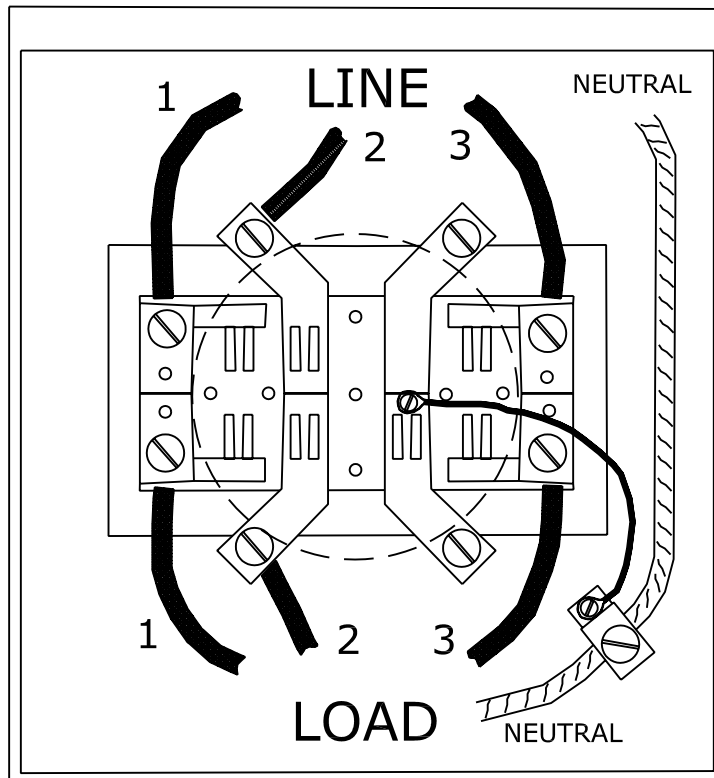


THREE-PHASE WYE SELF CONTAINED METERING

- Meter base will be provided by the Cooperative.
- Maximum 320 amp service. For larger services, transformer rated metering will be used (contact the Engineering Department).

CONNECTIONS

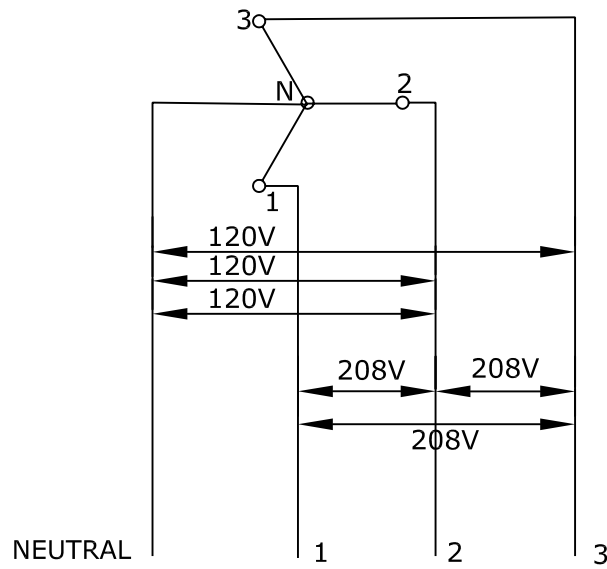

Revised 4/11/03 by LB

FIGURE 3